


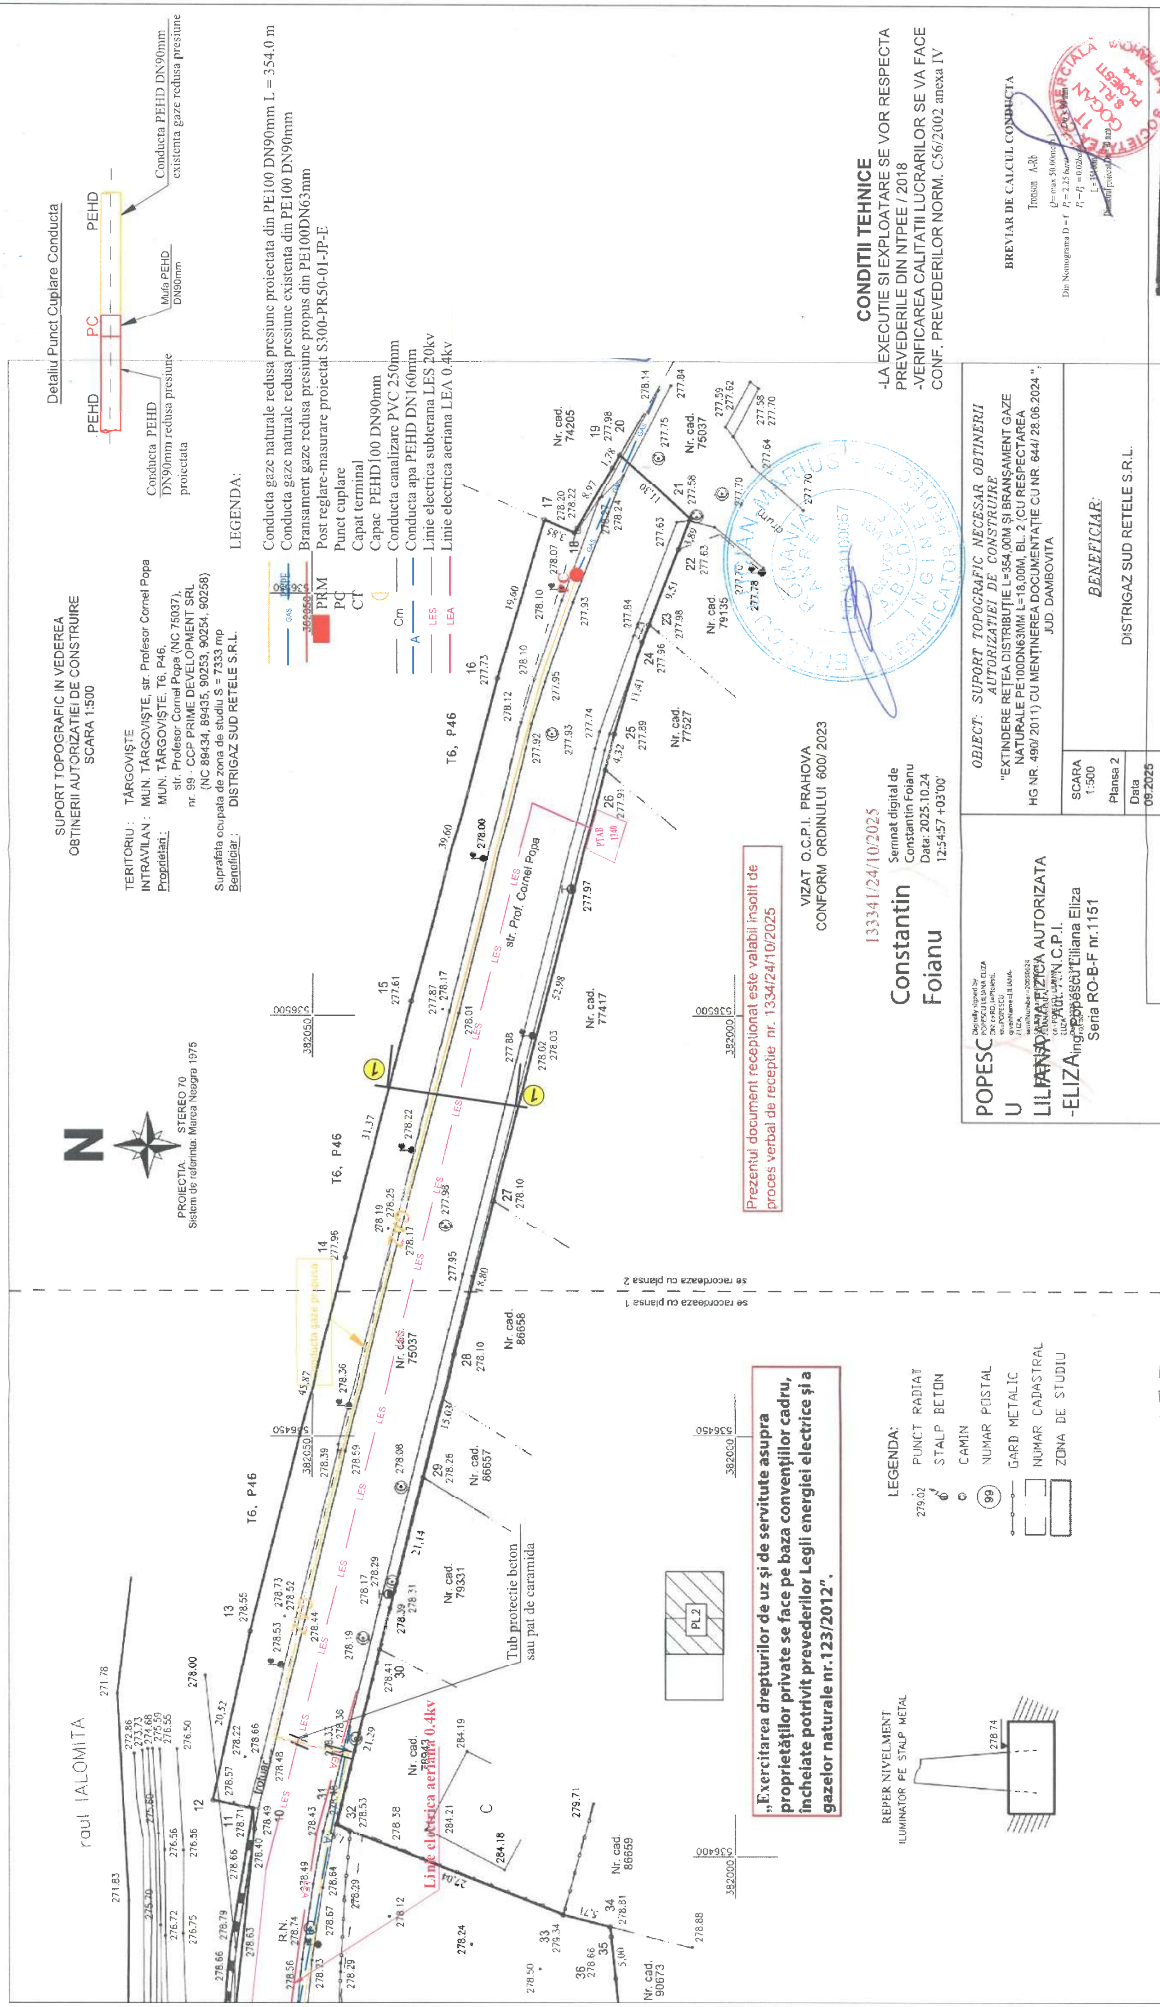

CONDITII TEHNICE
-LA EXECUTIE SI EXPLOATARE SE VOR RESPECTA
PREVEDERILE DIN NTPEE / 2018
-VERIFICAREA CALITATII LUCRARIILOR SE VA FACE
CONF. PREVEDERILOR NORM. C56/2002 anexa IV

BREVIER DE CALCUL CONDUCTA

Transmis. A-36

$U^2 = \max. 50.000 \text{ v.}$
 $P_1 = 2.25 \text{ kw.}$
 $P_2 = 12 = 0.020 \text{ kw.}$
 $I = 15.000 \text{ amp.}$

Die Nomograma D-f

Stamp: COMMERCIAL BANK OF THE ...

SCARA	1-500
Planşa 2	
Data	
09-2025	

133341/24/10/2025

POPESC
U
LILIANA POPESCU
-ELIZA
-ELIZA

(99) ☐ NUMAR POSTAL
☐ GARD METALIC
☐ NUMAR CADASTRAL
☐ ZONA DE STUDIU

—
